

Decentralized Wastewater treatment is the green future!



31th of March 2021
Sybrand Metz
Technical Director @ Desah
s.metz@desah.nl

Take home messages



- Circular wastewater treatment is better at local, decentralized level
- Vacuum toilets save 25% drinking water
- Wastewater streams are separated at the source, allowing for an effective treatment (black water/grey water)
- Green waste can be added to the wastewater treatment delivering more energy
- Black water treatment recovers biogas, nutrients
- 30% of the heat for heating houses can be extracted from grey water
- High quality water from grey water allowing reuse
- No sewer necessary

Our approach

➤ Closing loops

- Energy loop



- Nutrient loop



- Water loop



Easier and cheaper at a local (decentralised) level

Whether a compound is defined as waste or as a resource is greatly depending on its concentration and the people's interest

Wastewater is concentrated by vacuum toilets




- Vacuum toilets flush with 1-1.5L of water and 100L of air (Conventional toilets -> 5-7 L).
- A reduction of 36L/p/d water (25% of total water consumption)



The concept: Separation at source concept

Applicable in new build environment, housing districts, hotels, offices, resorts etc.

No expensive central sewer system

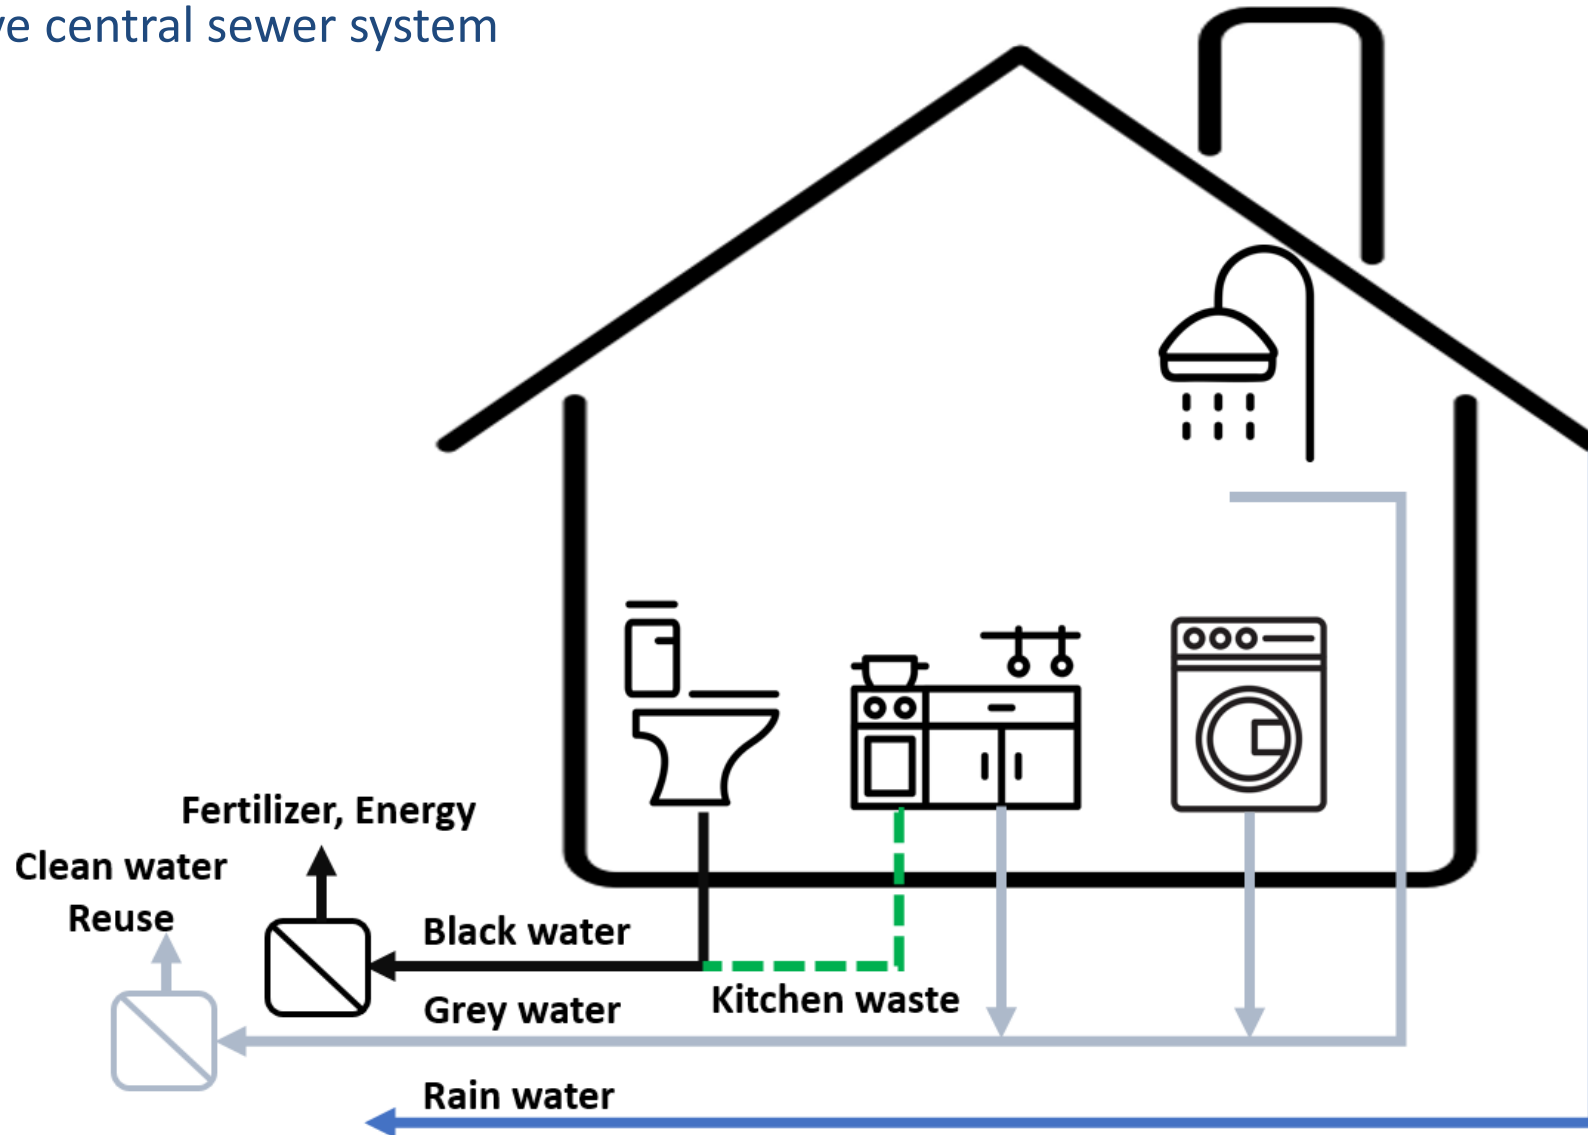


Black water (8%)
vacuum drainage

Grey water (92%)
gravity sewer

Sound vacuum toilets comparable to water flushed toilets




30% water saving through vacuum toilets

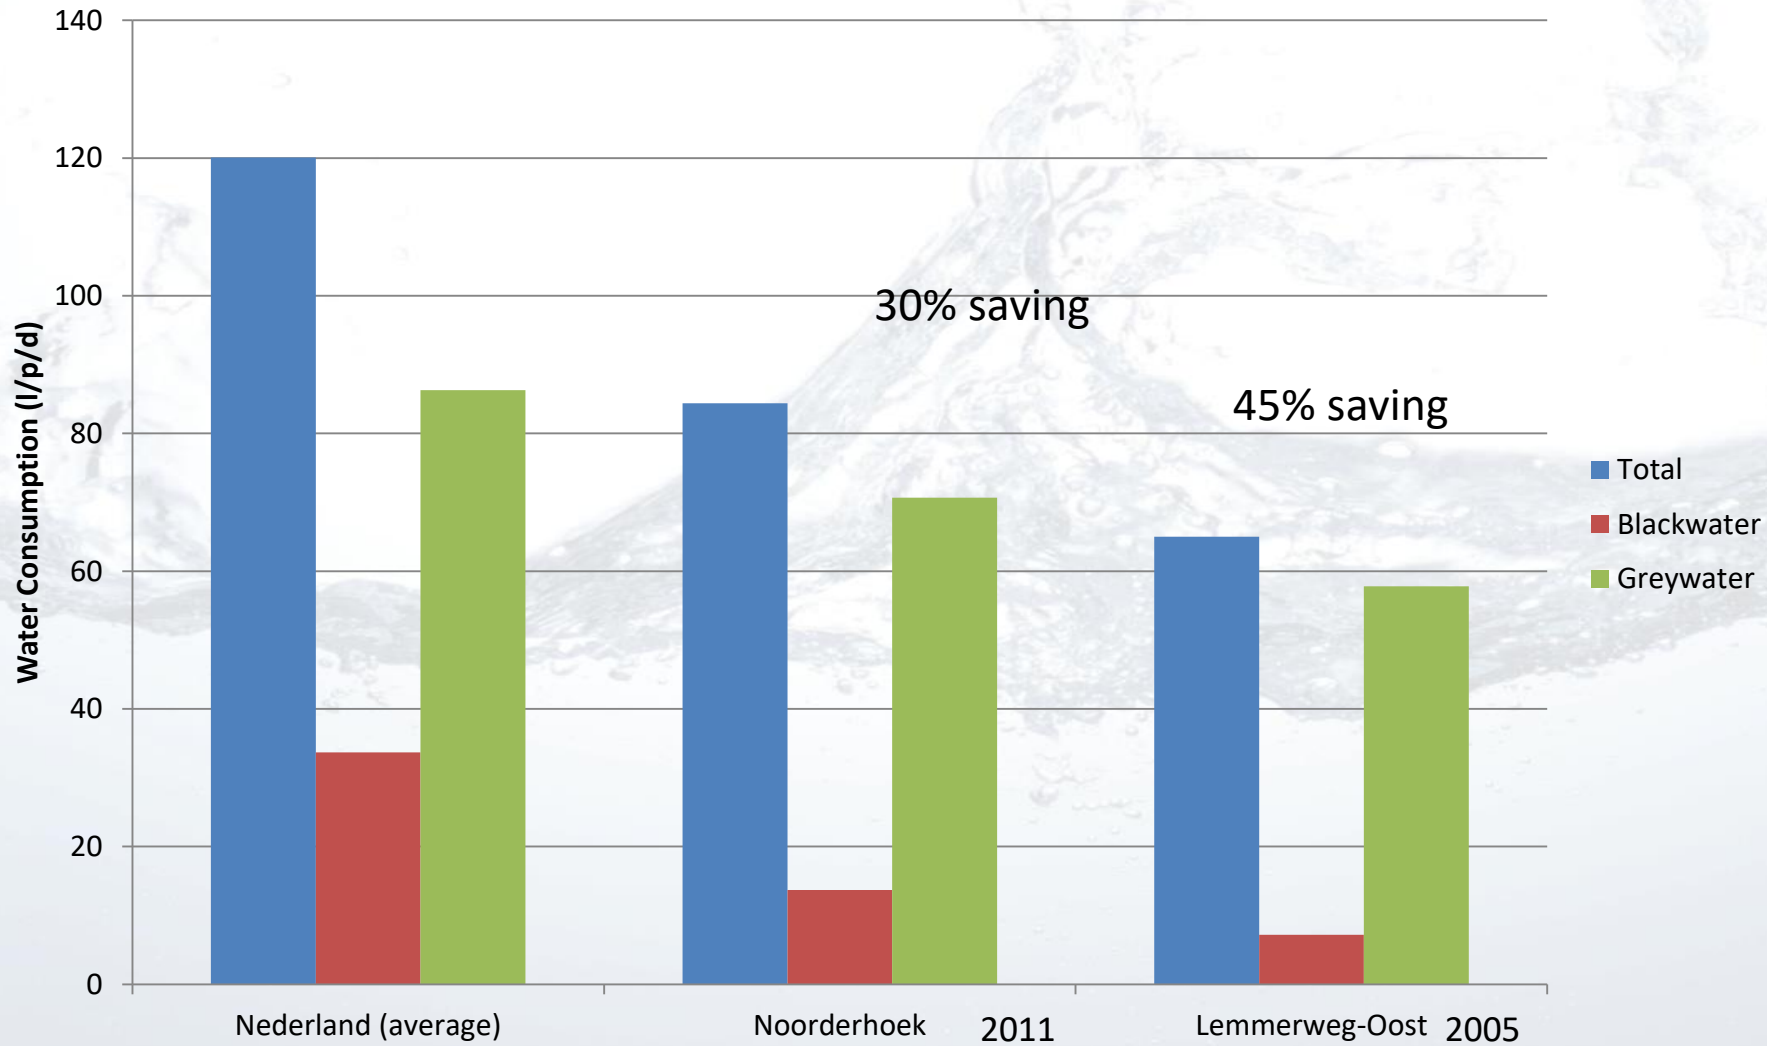

Green waste can be added to the black water through a kitchen grinder.



Kitchen grinders: better green waste separation

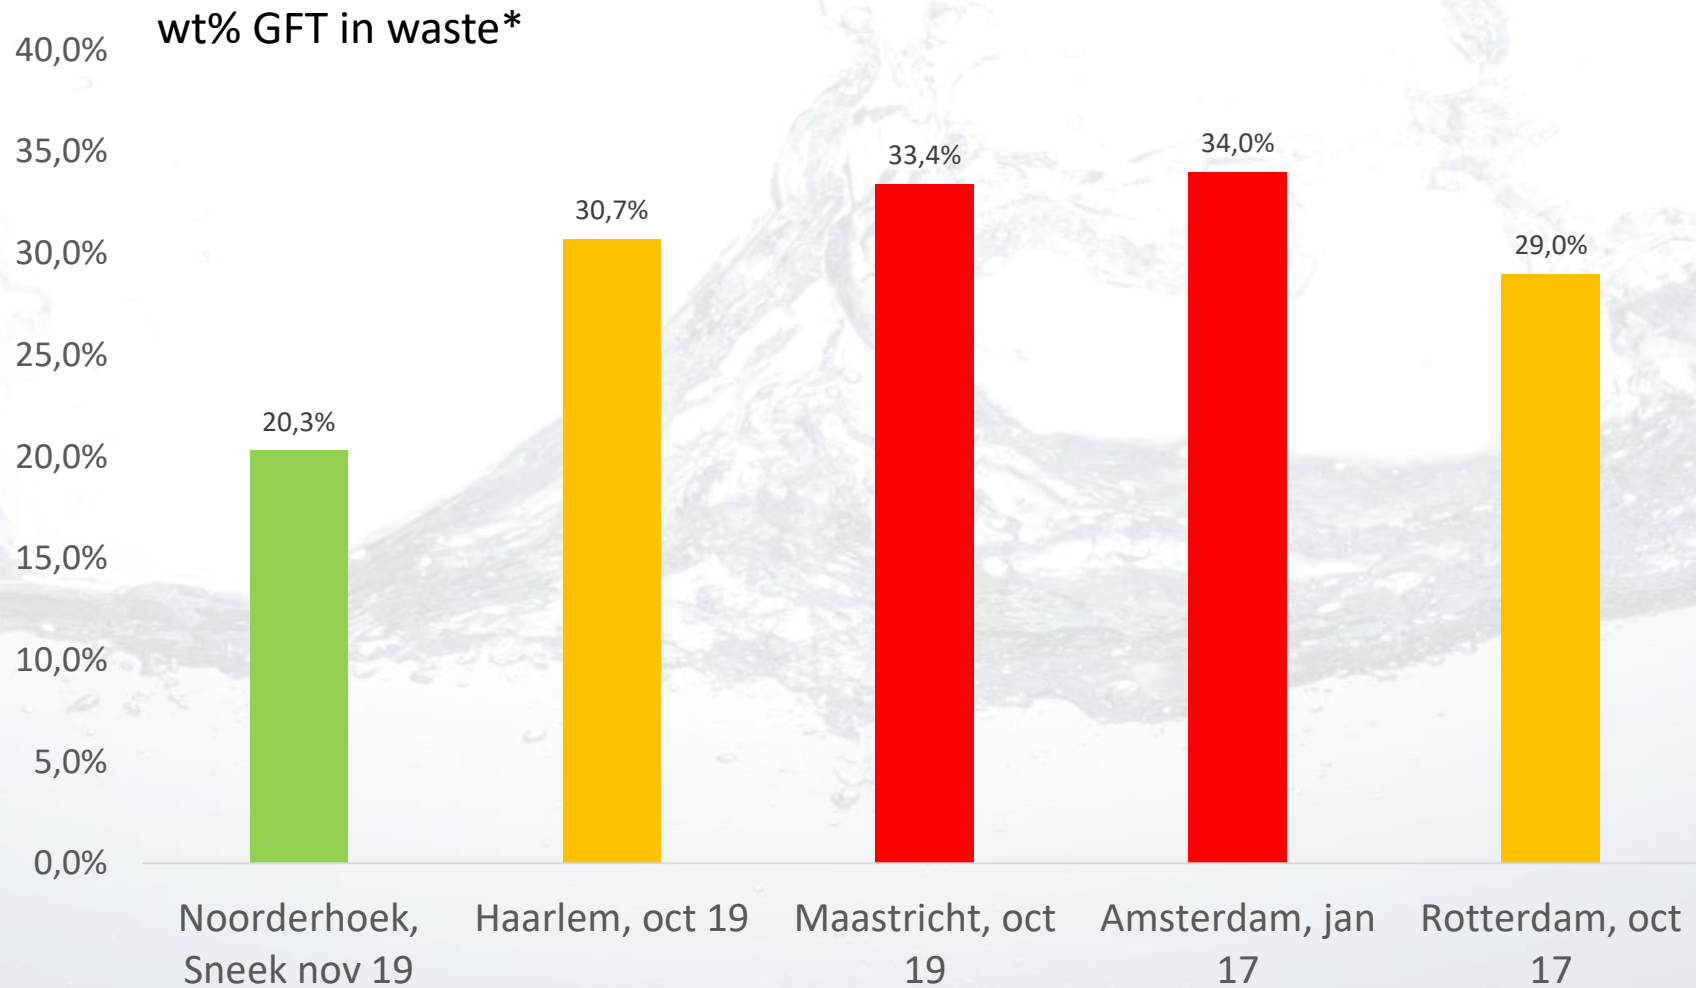

*CREM, waste management

Effective wastewater treatment through source separation



Black water (vacuum toilet):

High organic levels -> digestion generates biogas

High concentrations of nutrients -> fertilizers can be recovered easily

Hormones and medicine traces can be removed more effectively

Grey water

Less polluted -> less energy needed for treatment

high temperature -> recovery of heat

Low heavy metal and salt concentration (good for irrigation)

Application of source separation





- Buildings (e.g. hotels, resorts, offices and recreational facilities) and housing estates
- Rural areas and remote locations (e.g. drilling sites, mining sites and army bases)
- Newly build districts and districts converted to high rise building (sewage/WWTP can't handle the hydraulic load)

Noorderhoek, Sneek the Netherlands




230 Houses (2010)

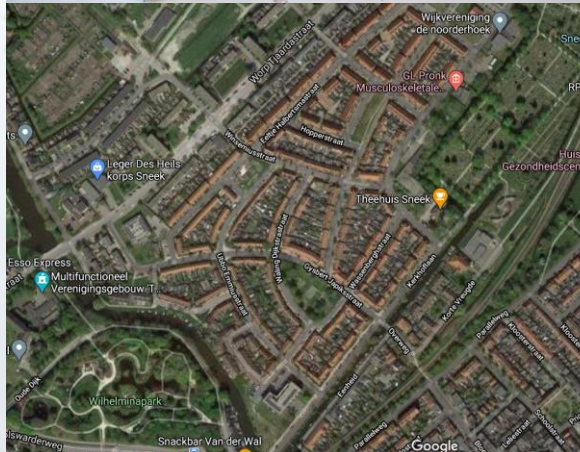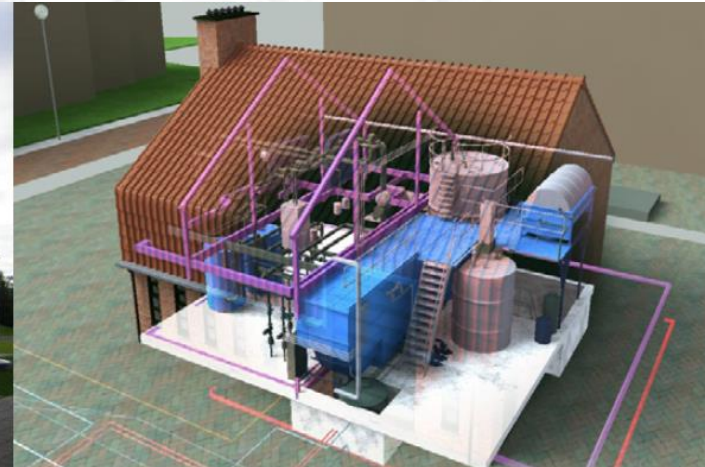

Greywater buffer

Vacuum system


Process scheme

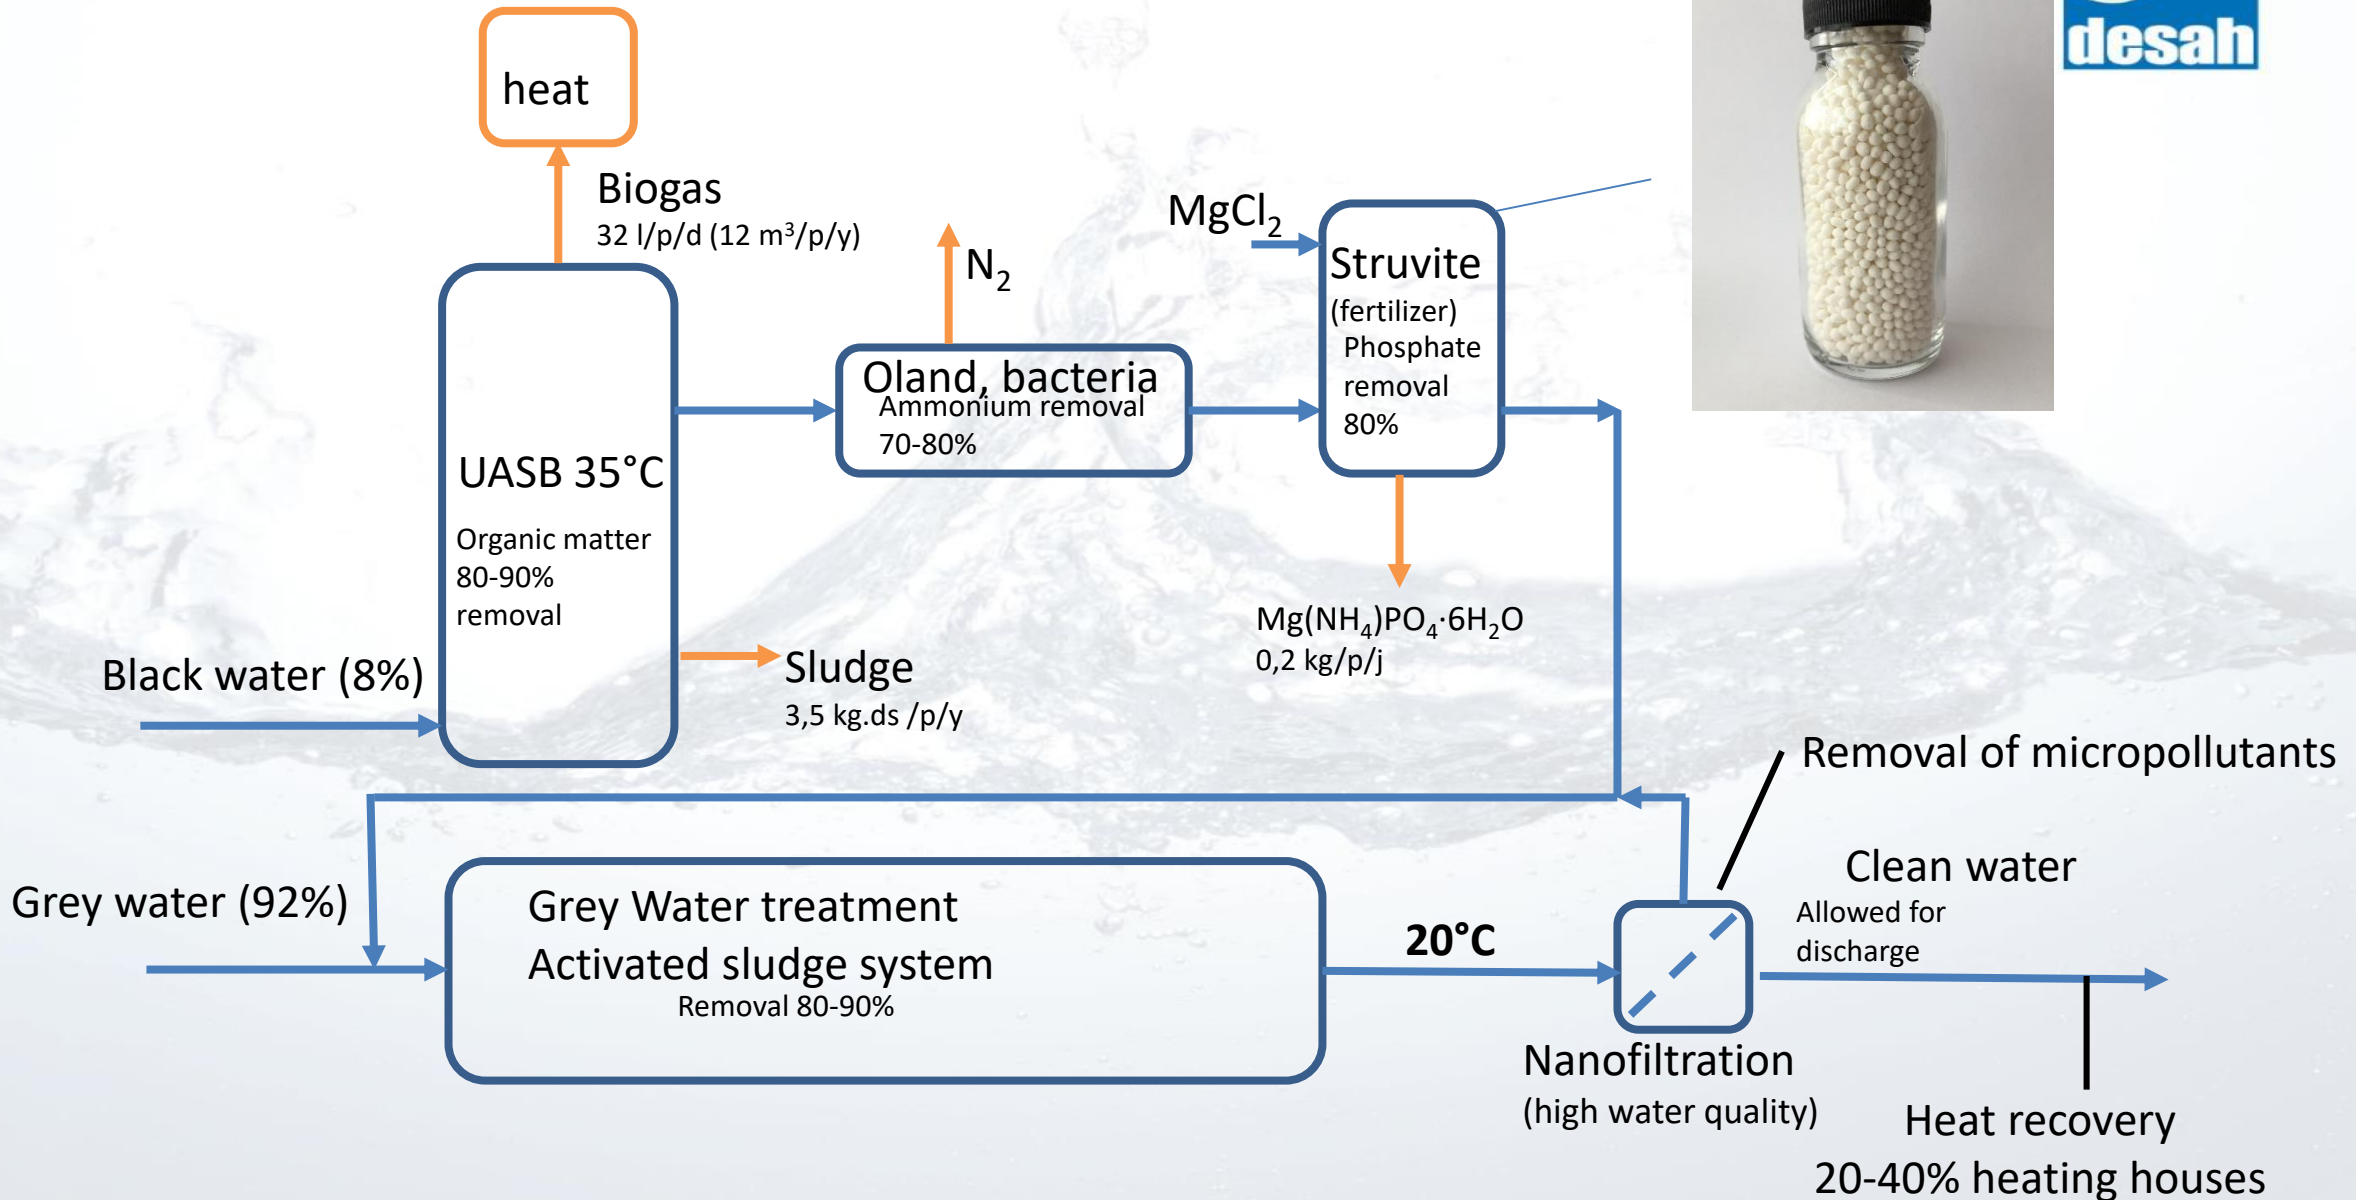

Case studies, Sneek, The Netherlands



2005, 32 houses with vacuum toilets

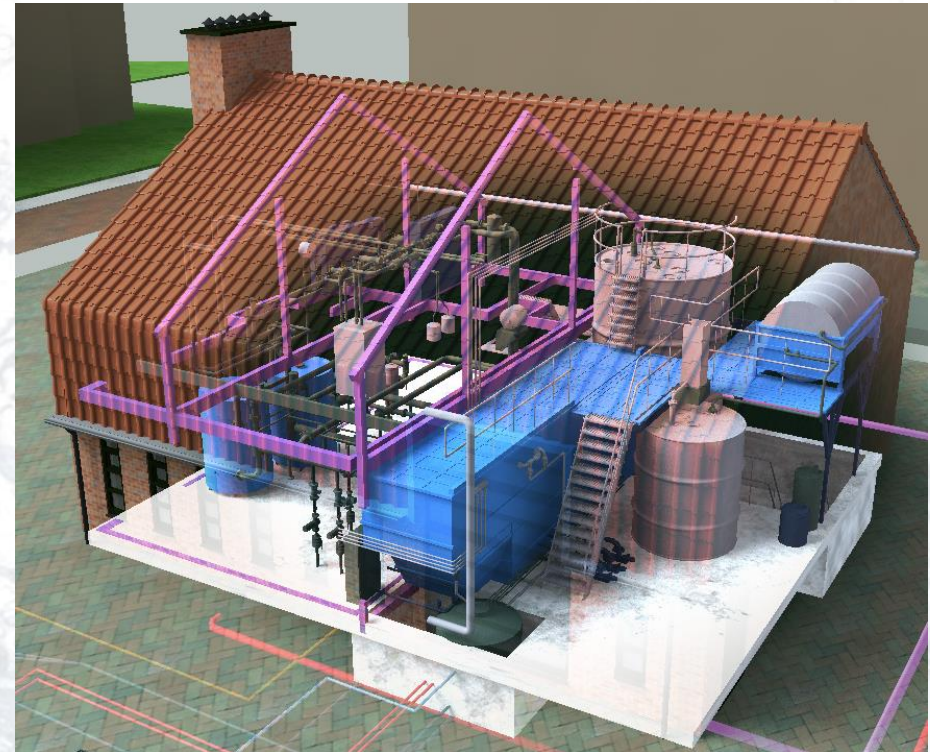


2010, 230 houses with vacuum toilets and kitchen grinders

Results:


- 25% less drinking water use
- Better collection green waste (30% more separation)
- 12 m³ biogas per person per year
- 2-3 times lower sludge production (no heavy metals)
- Struvite recovery
- Heat recovery from warm effluent (30% of total heating needs)
- Clean effluent, no micropollutants!
- No central sewer system

Micropollutants are better removed in source separated sanitation

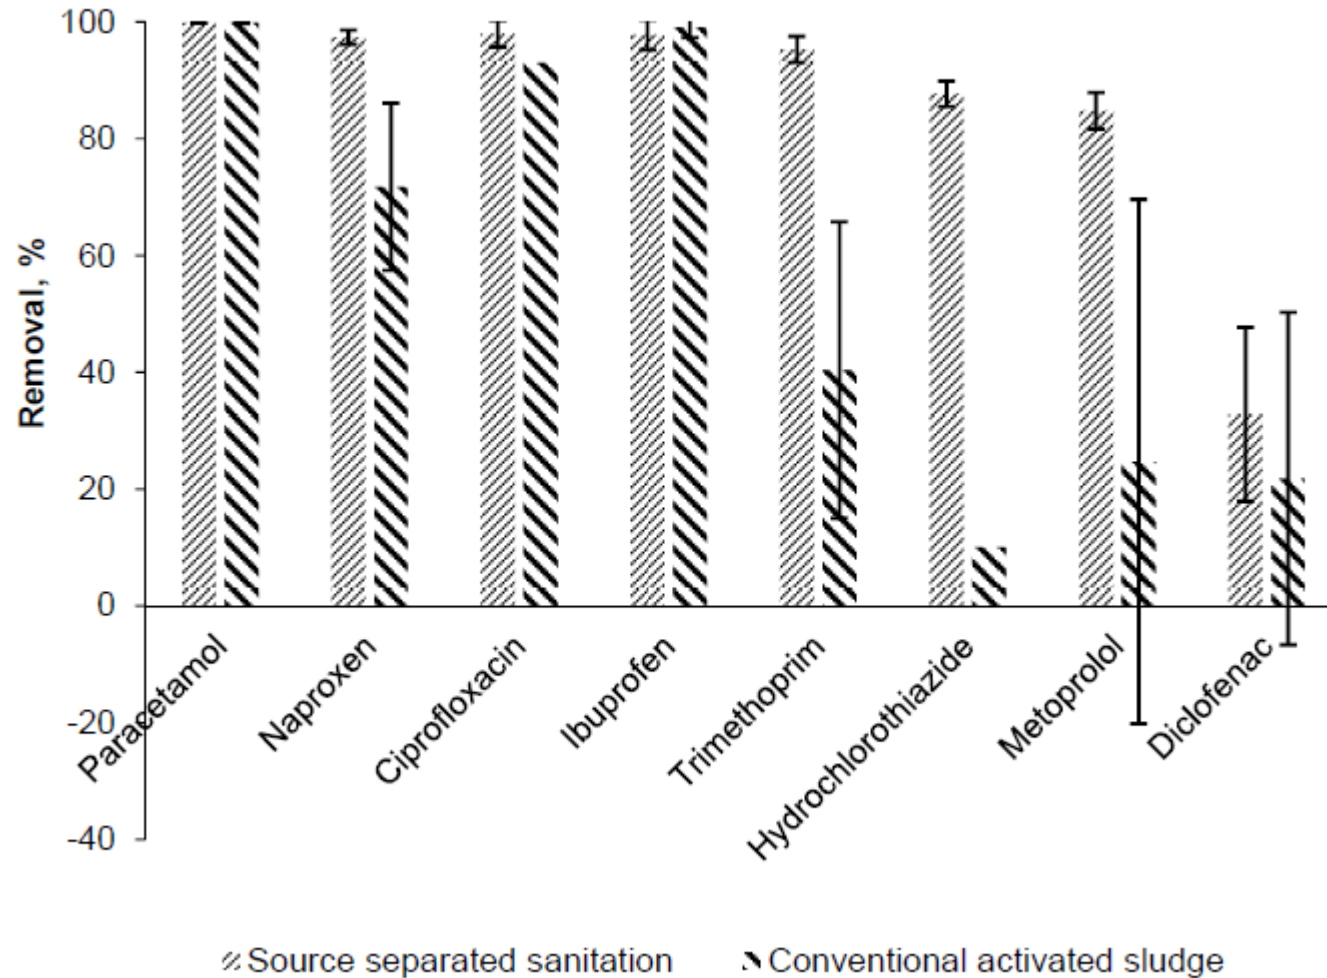


* Thesis A. Butkovskyi
Removal of micropollutants in source separated sanitation


High water quality after treatment with nanofiltration

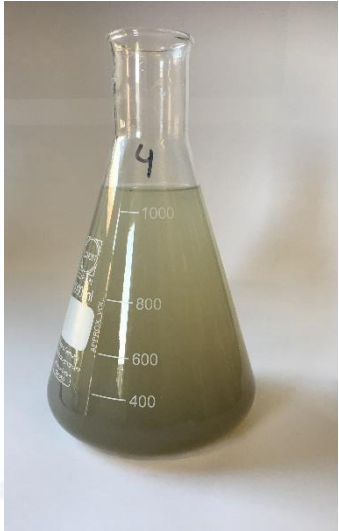

Grey water influent

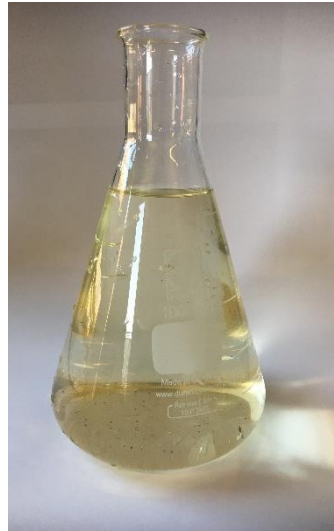

After activated sludge

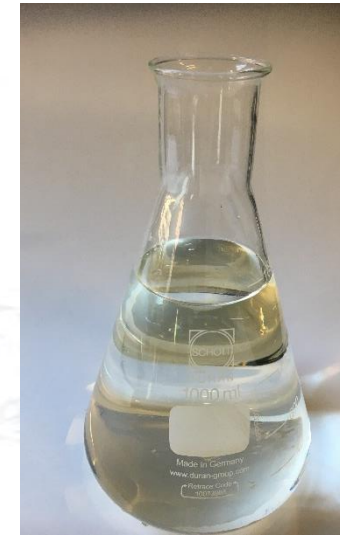

After nanofiltration


Results grey water treatment plant:

Parameter	unit	Influent	Effluent without NF	Discharge requirements wastewater	Optional: Effluent + NF (high water quality)
Organic material (COD)	[mg/l]	630	70	125	13
Particles (TSS)	[mg/l]	200	20	-	-
Total Nitrogen (TN)	[mg/l]	26	11	15	4
Ammonium (NH ₄ -N)	[mg/l]	12	2	-	0,37
Nitrate (NO ₃ -N)	[mg/l]	0,5	0,35	-	0,22
Total Phosphorous (TP)	[mg/l]	9,5	1,2	2	0,34
Bacteria (CFU)	[#/100 ml]	>1000	>1000	-	0

Heat recovery from wastewater



- Decentral treated wastewater is warm $\pm 20^{\circ}\text{C}$ and locally available
- This heat can be used for a ATEs system or heat pump
- Heat content of the wastewater represents 30% of the heating needs

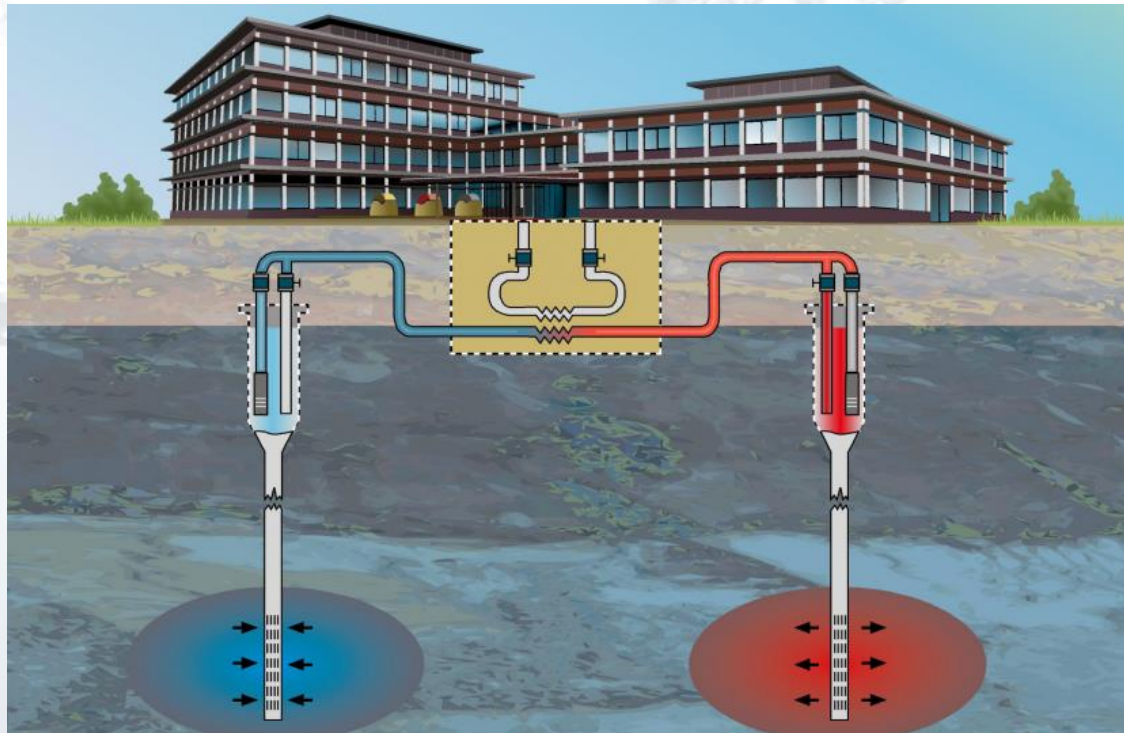

Aquifer Thermal Energy Storage
Disbalance in heating and cooling
Heat of wastewater can be used to charge
the cold well

Energy balans positive for decentralized systems



		Desah	Reference WWTP
Drinking water production and transport	kWh/p/j	-35	-58
Heat demand treatment	kWh/p/j	-126,7	-6
Gasoline consumption	kWh/p/j	0	-3
Heat pump*	kWh/p/j	167,7	0
Electricity heat pump	kWh/p/j	-67,3	0
Heat biogas**	kWh/p/j	149,9	6
Electricity treatment	kWh/p/j	-72,25	-75
Electricity production	kWh/p/j	0	61
Energy transport wastewater	kWh/p/j	-72	-13
Total primair	primair	-46	-88

*heat pump not optimized (low COP)

** CHP unit could also deliver electricity

Financial analysis



		Noorderhoek (optimized)	Reference (wwtp 100.000 p.e.)
Transport	€/PE*y	18	18
Additional costs sanitair	€/PE*y	22	-
WWTP	€/PE*y	97	47
Heat and kitchen-waste	€/PE*y	-52	-
Drinking water (1,25 Euro/m ³)	€/PE*y	-12	-
Total	€/PE*y	73	65

- at 1200 p.e. source separated system is 11 % more expensive compared to wwtp of 100.000 p.e.
- equal at 50.000 p.e. wwtp
- local water reuse not taken into account.
- micropollutant removal not taken into account.

Decentralized vs Centralized



Compared with a centralized WWTP (100.000 p.e.) the DeSaH concept:

- Similar OPEX (incl. depreciation) at a scale of 3000 p.e.
- 200% more energy production than an energy optimized plant, equal to 25% of total household heating demands
- Recovers 250% more P than the current state of the art;
- Produces 2x times less surplus sludge, with higher quality
- Footprint is ~0.2% of the total footprint of the connected houses
- Removal of micropollutants and effluent with a high quality

References:



The Netherlands: Digester (office building Den Hage)




Amsterdam (Buiksloterham, 2021; 1500 p.e.)



Amsterdam (Strandeiland, 2024; 20.000 p. e.)



Sweden (Helsingborg, 2020; 2000 p.e.)

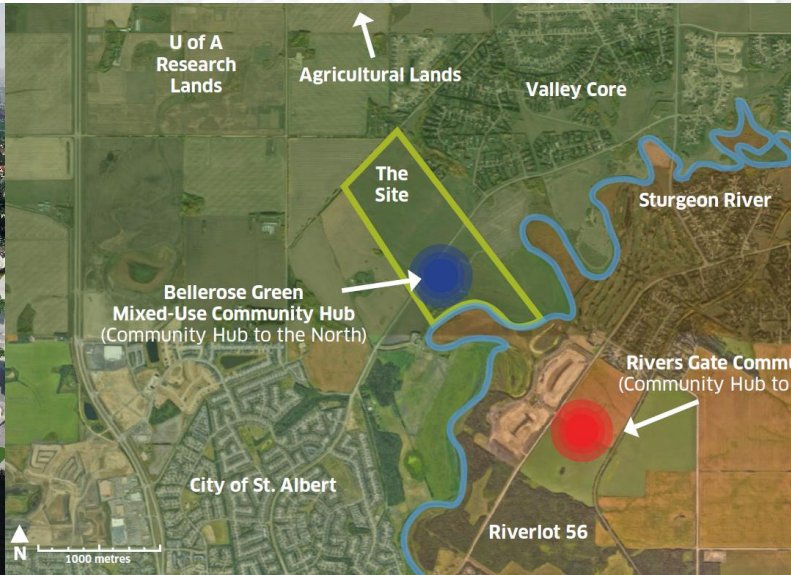


Canada (St. Albert, 2021; 1500)



Ukraine (The Crimea, 2008; 1500 p.e.)

Zirkuläres Wasser, Energy und Dünger

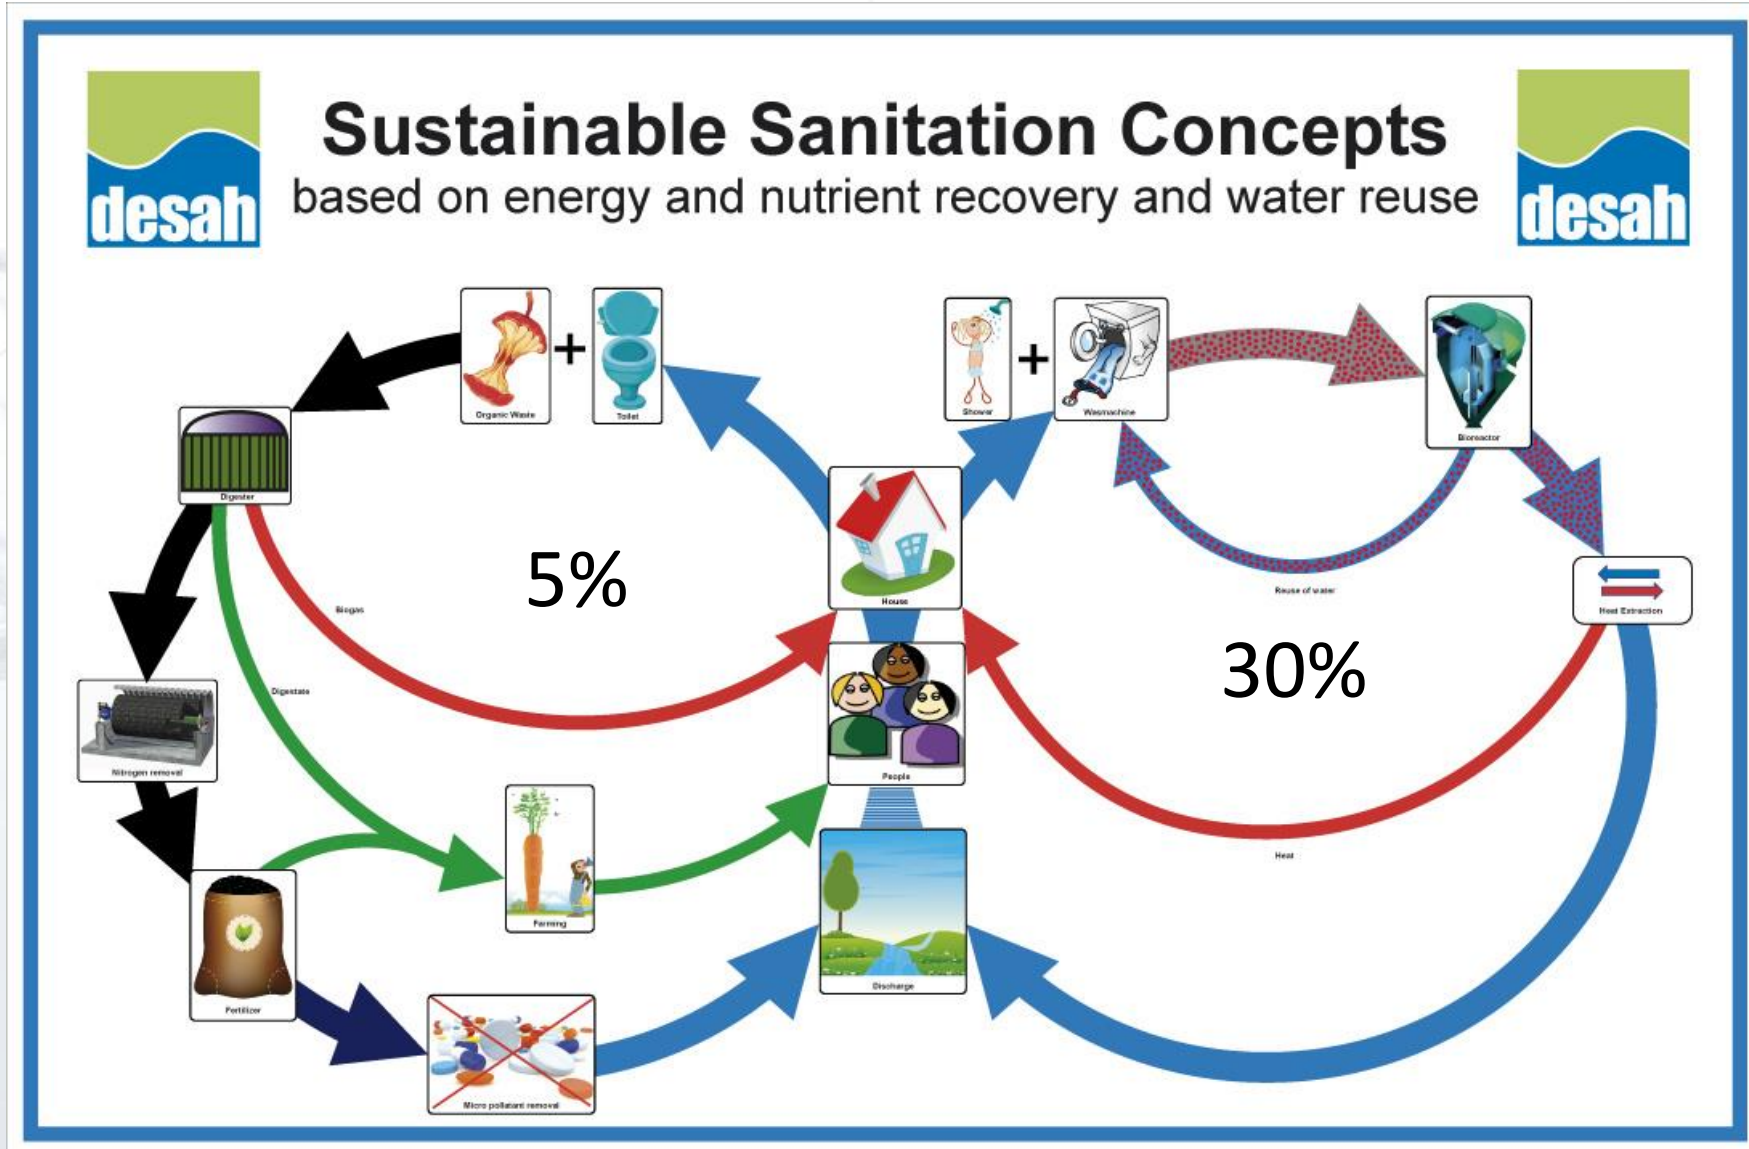

Take home messages



- Circular water treatment is better at local, decentralized level
- Vacuum toilets save 25% drinking water
- Wastewater streams are separated at the source, allowing for an effective treatment (black water/grey water)
- Green waste can be added to the wastewater treatment delivering more energy
- Black water treatment recovers biogas, nutrients
- 30% of the heat for heating houses can be extracted from grey water
- High quality water from grey water allowing reuse
- No sewer necessary

Desah offers:



- More than 15 years of experience in decentralized wastewater treatment
- Several reference projects available in the Netherlands and Europe
- Provider of technology
- Feasibility studies, design, delivery, construction, management and maintenance of installations
- Possible next steps:
 - Quick scan -> feasibility study -> conceptual design -> pilot project



Save Water



Recover Energy



Collect Fertilizers

Contact info



- www.desah.eu
- s.metz@desah.nl

 <https://www.youtube.com/channel/UCuD4b8eP6PDKZMt-3NoD3sg>

 <https://www.linkedin.com/company/desah/>

 <https://www.facebook.com/desahbv/>

Additional slides



References vacuümtoilets in houses/buildings



650 woningen Hamburg:

<https://www.hamburgwatercycle.de/en/the-jenfelder-au-neighbourhood/the-hwc-in-the-jenfelder-au/>

Den Haag, kantoorgebouw ministerie:

<https://english.rijksvastgoedbedrijf.nl/real-estate/rijnstraat-8-the-hague-government-office>

Sneek 230 woningen:

<https://www.waterschoon.nl/>

114 appartement en 15 woningen in Kerkrade:

<https://www.superlocal.eu/primeur-circulair-woningconcept-ontwikkeld-binnen-superlocal-project/>

Onderzoeksgebouw Wetsus:

www.wetsus.eu

Buiksloterham Amsterdam:

<https://www.waternet.nl/werkzaamheden/nieuwe-sanitatie/>

Strandeiland Amsterdam (8000 woningen):

<https://www.winnovatie.nl/innovatie/nieuwe-sanitatie-strandeiland>

400 appartementen in Gent de wijk van de toekomst:

<https://ducoop.be/initiatieven>

Helsingborg, Sweden 350 appartementen en 3 kantoorgebouwen:

<https://hplus.helsingborg.se/reco-lab/>

Het meest duurzame gebouw ter wereld:

<https://jetsgroup.com/jets-magazine/article/en/the-most-sustainable-office-building-in-the-world>

Kantoor Desah

www.desah.nl

NIOO wageningen

- Cruiseschepen, vliegtuigen, treinen

Sludge composition UASB











	Heavy metal (mg/kg ds)	Desah*	Reference WWTP 30.000 p.e.	Reference WWTP 100.000 i.e.
Slib productie (kg.ds /inw/j)		3,5	17	16,7
As	15	5,7	16	
Cd	1,25	0,8	1,3	
Cr	75	16	37	
Cu	75	268	400	
Hg	0,75	0,6	1,0	
Ni	30	16	28	
Pb	100	43	127	
Zn	300	975	1096	

*UASB sludge lower heavy metal content compared to cow manure

Advantages DeSaH



-  Energy production
-  Water saving of at least 25%
-  Treatment of wastewater and organic waste
-  Closing energy and nutrient loop
-  No harmful by-products
-  Very high removal efficiencies for COD and nitrogen
-  More cost effective on the long run
-  Its operation generates money in stead of consuming