

CORONASTEP Report 17 August 2020

SARS-CoV-2 Sewage Surveillance in Luxembourg

Summary

Monitoring of SARS-CoV-2 in wastewater has been established on a weekly basis in Luxembourg from 31st March 2020 for a total of 132 samples so far. Currently eleven wastewater treatment plants (WWTP) are monitored for SARS-CoV-2 in the inlet pipe (Table 1). For the WWTP of Schifflange, archived frozen samples have been analysed back to October 2019.

In general, since the beginning of the sampling carried out within the framework of the CORONASTEP project, the dynamics of SARS-CoV-2 RNA copies in influents of WWTPs has followed the dynamics of active COVID-19 cases observed at the national level (Table 2), whatever the WWTP studied.

However, three distinct profiles can be distinguished:

- A first group comprising the major WWTPs of the country (Beggen, Schifflange, Bettembourg, Pétange) always presents the highest viral concentrations (superior to 10^4 RNA copies/L) compared to the other plants. These concentrations closely follow the dynamics of the contaminations in the population (Figure 1 et 2 for Beggen and Schifflange, respectively).
- In the second group, comprising the treatment plants of Hesperange, Mersch, Bleesbruck, Grevenmacker, Uebersyren and Echternach, the detected SARS-CoV-2 RNA concentrations are generally lower (between 10^3 and 10^4 RNA/L copies) but nevertheless follow the dynamics of the second wave. For some of them, the viral dynamics may appear fuzzier (Grevenmacker, Uebersyren, Echternach, Bleesbruck), but this is partly due to a lower number of samples analysed. Furthermore, it is important to remember that most of these WWTPs could not be sampled during the first wave of contamination.
- The third group is the Troisvierges treatment plant. No virus had been detected in the wastewaters of this plant until the middle of the second wave, with a suddenly very high value. Two other samples have tested positive to date, but this plant certainly needs to be analysed at a higher rate in order to draw more accurate conclusions.

The last samples analysed (week 33) seem to show the beginning of a decrease in the SARS-CoV-2 RNA concentrations found in the wastewaters, except for the Beggen sewage treatment plant. This observation needs however to be confirmed in the coming weeks. The Figures 3 and 4 shows the complete set of data, and the details of the second wave, respectively.

Table 1- Timing of sewage sampling

| Wastewater Treatment Plant | Max capacity (eq. inhabitants) | Inhabitants connected | 2019 | | | | 2020 | | | | | | | | | | | | | | | | Total samples | | | | | | | | | |
|----------------------------|--------------------------------|-----------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|-----------|----------|-----------|----------|----------|---------------|-----------|----------|-----------|-----------|-----------|-----------|------------|---------|----|
| | | | Week 41 | Week 43 | Week 46 | Week 51 | Week 3 | Week 7 | Week 9 | Week 11 | Week 14 | Week 15 | Week 16 | Week 17 | Week 18 | Week 19 | Week 20 | Week 21 | Week 22 | Week 23 | Week 24 | Week 25 | | Week 26 | Week 27 | Week 28 | Week 29 | Week 30 | Week 31 | Week 32 | Week 33 | |
| Beggen | 210000 | 139731 | | | | | | | | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | 20 |
| Bettembourg | 95000 | 53606 | | | | | | | | | | | | | | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | 14 |
| Schifflange | 90000 | 68143 | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | 28 |
| Bleesbrück | 80000 | 30930 | | | | | | | | | | | | | | | x | x | x | x | x | x | x | | x | x | x | x | x | x | 12 | |
| Mersch | 70000 | 30473 | | | | | | | | | | | | | | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | 16 | |
| Pétange | 50000 | 59481 | x | x | x | x | x | x | x | | | | | | | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | 24 | |
| Hesperange | 36000 | 15479 | | | | | | | | | | | | | | x | x | x | x | x | x | x | x | x | x | x | x | x | x | x | 16 | |
| Echternach | 36000 | 7499 | | | | | | | | | | | | | | | | | x | | | | | x | x | x | x | x | x | x | 7 | |
| Uebersyren | 35000 | 18600 | | | | | | | | | | | | | | | | | x | | x | | x | x | x | x | x | x | x | x | 9 | |
| Grevenmacher | 47000 | 9835 | | | | | | | | | | | | | | | | | | x | | x | | x | x | x | x | x | x | x | 9 | |
| Troisvierges | 5000 | 3411 | | | | | | | | | | | | | | | x | x | x | x | x | | | x | | x | x | x | | 9 | | |
| Total | 754000 | 437188 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 5 | 5 | 6 | 8 | 10 | 8 | 11 | 8 | 9 | 7 | 11 | 9 | 11 | 11 | 11 | 10 | 164 | | |
| Pop Lux (2019) | | 613901 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 71.21% | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Table 2 - Summary of the screening of SARS-CoV-2 gene E in 24-h composite samples of incoming wastewater at different WWTP in Luxembourg. White: not tested sample, Green: negative samples for SARS-CoV-2 gene E, Yellow to red: positive samples for SARS-CoV-2 gene E, the intensity of the color is depending to the Ct values (number in the cases).

| WWTP | Inhabitants connected | 2019 | | | | | | 2020 | | | | | | | | | | | | | | | | | | | | | |
|---------------|-----------------------|-----------------|---------|---------|---------|--------|--------|----------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|----------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| | | Before 1st case | | | | | | 1st wave | | | | | | | | | | | | 2nd wave | | | | | | | | | |
| | | Week 41 | Week 43 | Week 46 | Week 51 | Week 3 | Week 7 | Week 9 | Week 11 | Week 14 | Week 15 | Week 16 | Week 17 | Week 18 | Week 19 | Week 20 | Week 21 | Week 22 | Week 23 | Week 24 | Week 25 | Week 26 | Week 27 | Week 28 | Week 29 | Week 30 | Week 31 | Week 32 | Week 33 |
| Beggen | 139731 | | | | | | | | | 31.89 | 33.67 | 35.02 | 34.98 | 36.20 | 35.95 | 35.59 | 35.55 | - | - | - | - | 34.19 | 35.36 | 33.76 | 33.37 | 33.56 | 33.34 | 33.06 | 32.49 |
| Bettembourg | 53606 | | | | | | | | | | | | | | | - | - | - | - | - | 37.13 | 34.45 | 35.26 | 34.83 | 33.04 | 33.99 | 33.29 | 32.75 | 34.40 |
| Schifflange | 68143 | - | - | - | - | - | 37.04 | 36.04 | 34.04 | 35.70 | 35.87 | 35.16 | 36.61 | 35.77 | - | 35.20 | - | 36.60 | - | - | - | 36.65 | 34.90 | 34.36 | 34.59 | 33.17 | 34.12 | 33.18 | 34.66 |
| Bleesbrück | 30930 | | | | | | | | | | | | | | | - | - | - | - | - | - | 33.68 | 35.26 | 36.11 | | 35.41 | 35.68 | 35.93 | 36.54 |
| Mersch | 30473 | | | | | | | | | | | | 35.86 | 36.21 | - | 35.28 | - | - | - | - | - | 34.58 | 35.05 | 36.26 | 36.02 | 35.61 | 34.18 | 35.45 | 34.74 |
| Pétange | 59481 | - | - | - | - | - | - | 36.13 | | | | | 35.22 | 35.03 | - | - | 36.50 | 36.18 | - | 35.89 | 33.83 | 34.50 | 34.10 | 32.86 | 31.94 | 33.67 | 33.38 | 34.08 | |
| Hesperange | 15479 | | | | | | | | | | | | 36.99 | 36.13 | 36.75 | - | - | - | - | - | - | - | 36.00 | 37.46 | 36.41 | 35.57 | 34.72 | - | 35.81 |
| Echternach | 7499 | | | | | | | | | | | | | | | | | | - | - | - | | | 36.05 | 35.10 | 36.69 | 36.42 | 36.27 | - |
| Uebersyren | 18600 | | | | | | | | | | | | | | | | - | - | - | - | - | 35.50 | | 35.86 | 36.59 | 35.68 | - | 36.68 | 34.29 |
| Grevenmacher | 9835 | | | | | | | | | | | | | | | | - | - | - | - | - | 36.26 | | 35.82 | 37.86 | 34.81 | 35.13 | 35.81 | 35.65 |
| Trois Vierges | 3411 | | | | | | | | | | | | | | | - | - | - | - | - | - | | | - | | 31.61 | 34.75 | 34.92 | |
| Total | 437188 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Figure 1 – RT-qPCR quantification time-course monitoring of SARS-CoV-2 (E and N genes) in wastewater samples from Beggen wastewater treatment plant (from March to August 2020). Grey squares: daily-confirmed cases, blue dots: positive samples, blue cross: tested but negative samples, black line: limit of quantification (LOQ).

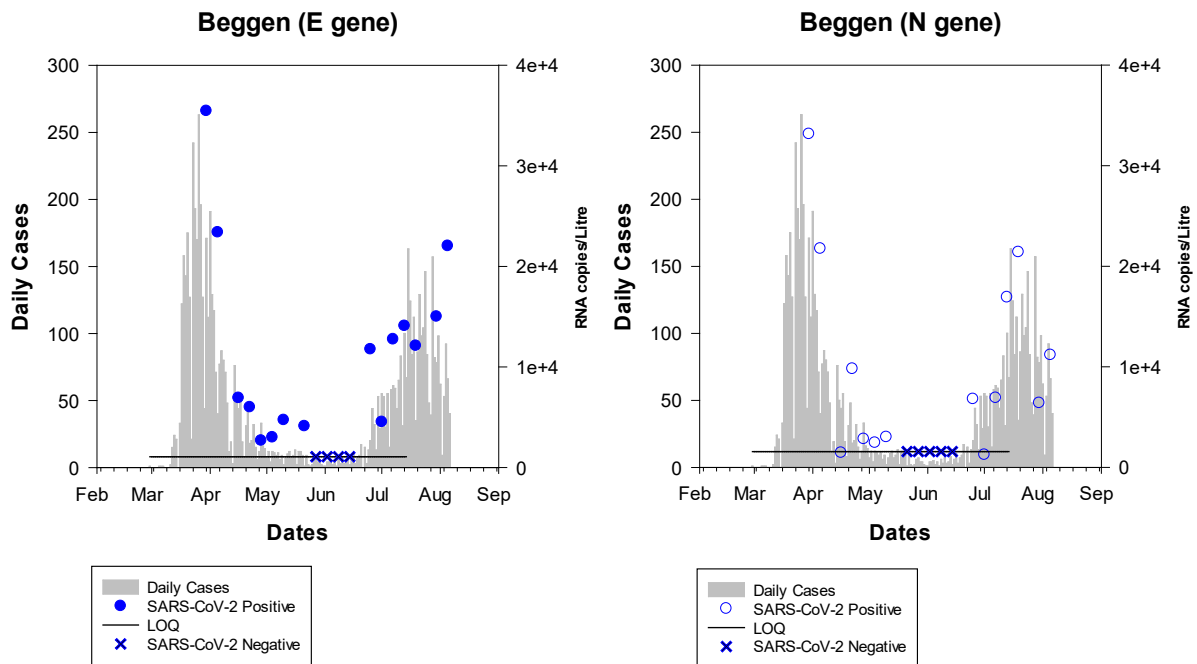


Figure 2 - RT-qPCR quantification time-course monitoring of SARS-CoV-2 (E gene) in wastewater samples from Schiffflange wastewater treatment plant (from Dec 2019 to August 2020). Grey squares: daily-confirmed cases, red dots: positive samples, red cross: tested but negative samples, black line: limit of quantification (LOQ).

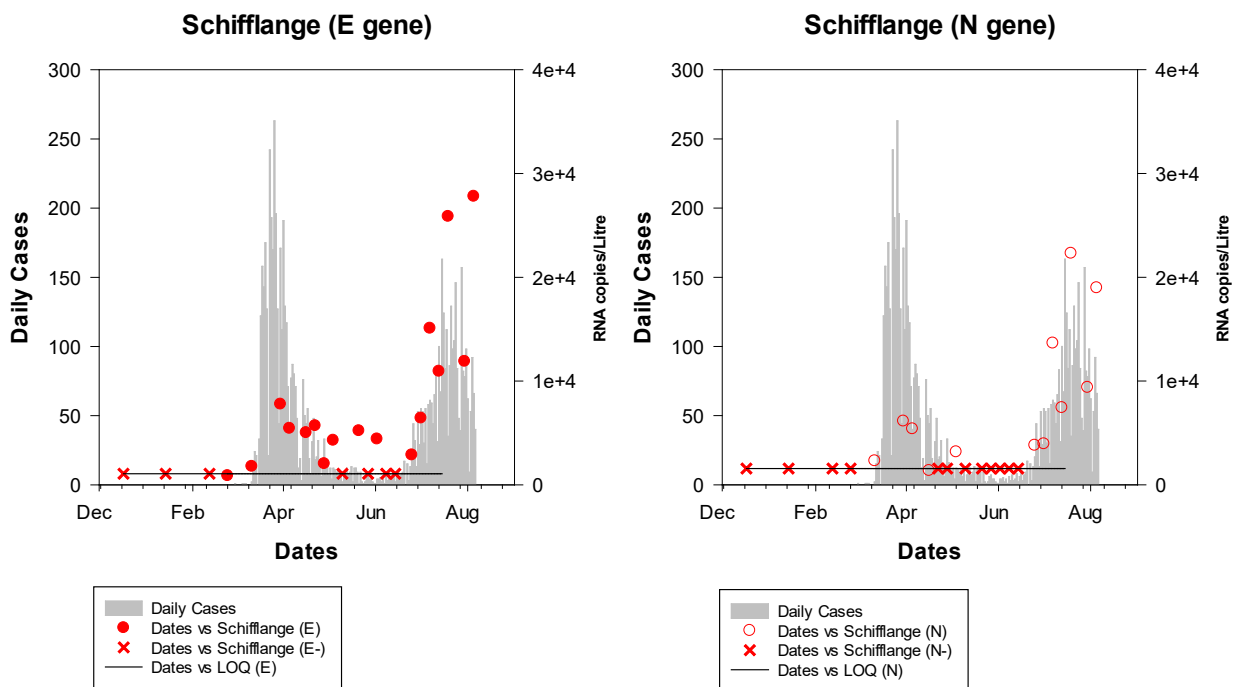
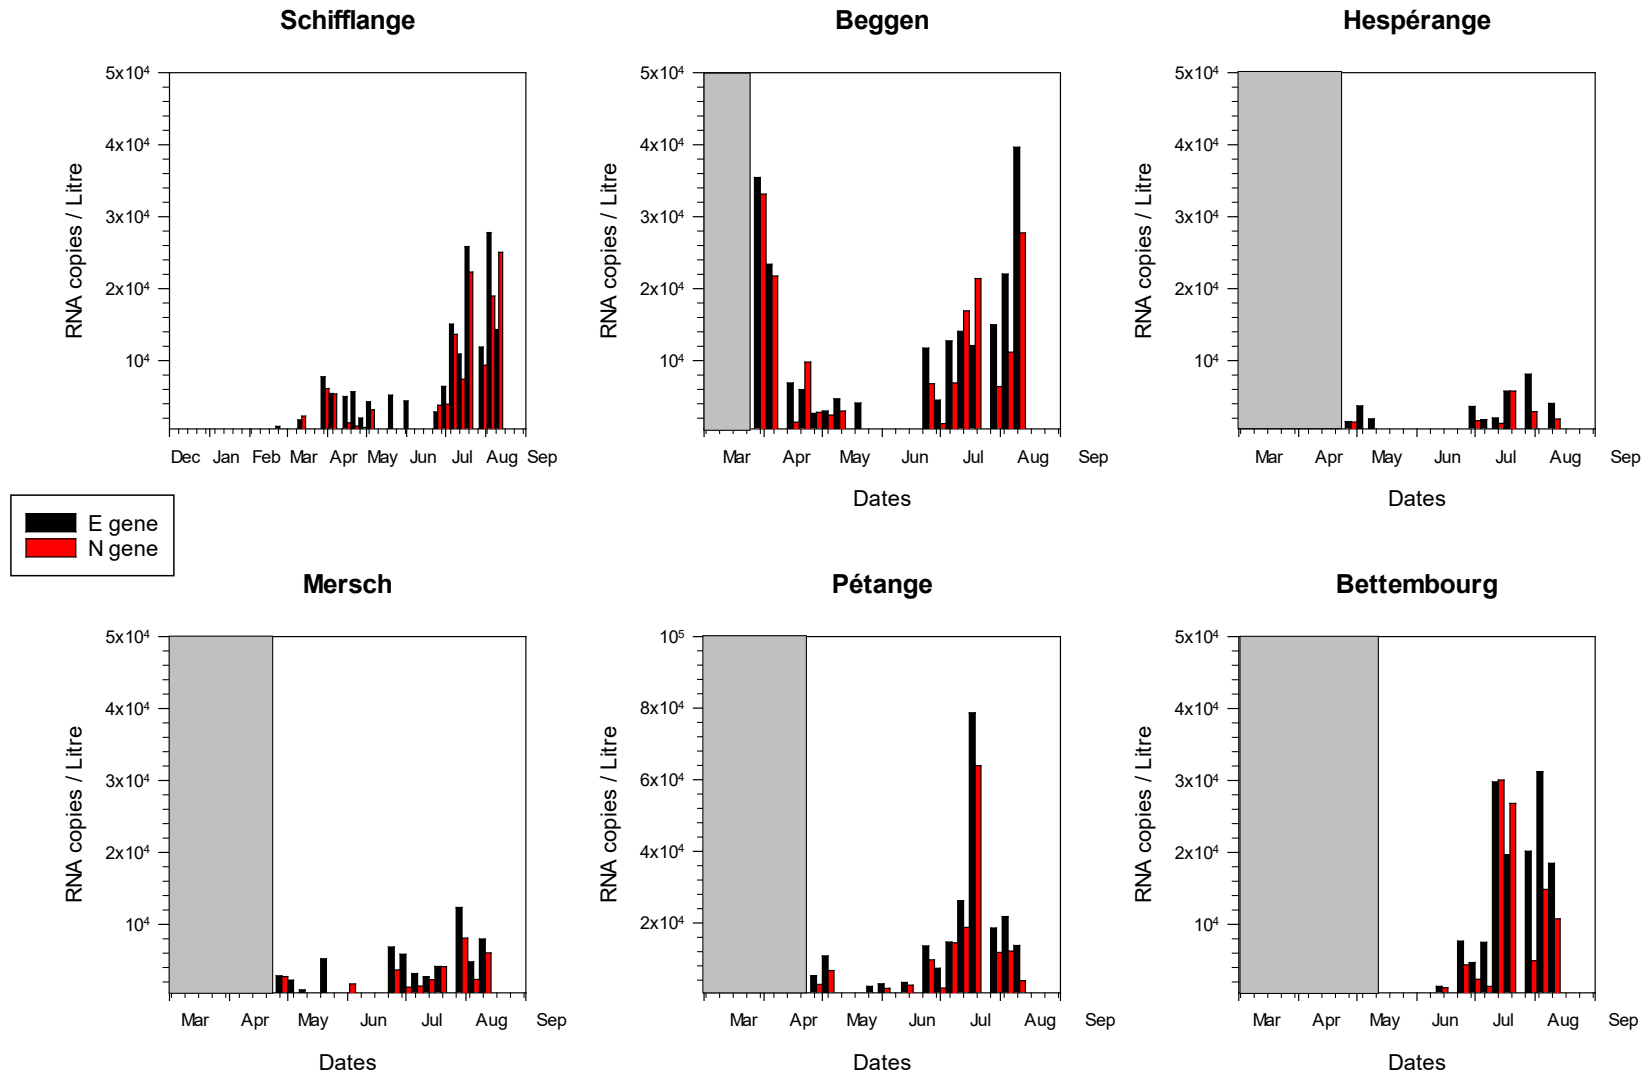


Figure 3 - Evolution of the SARS-CoV-2 genes (E and N) in the wastewater treatments in Luxembourg. Grey areas correspond to periods without sampling.









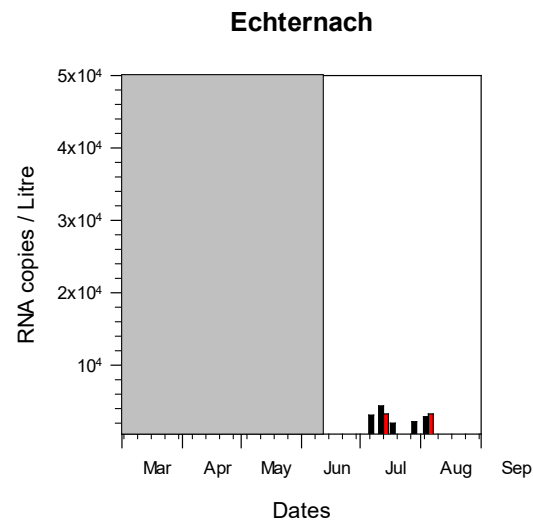



Figure 4 - Detailed evolution of the SARS-CoV-2 genes (E and N) in the wastewater treatment plants in Luxembourg from June 22nd, 2020.

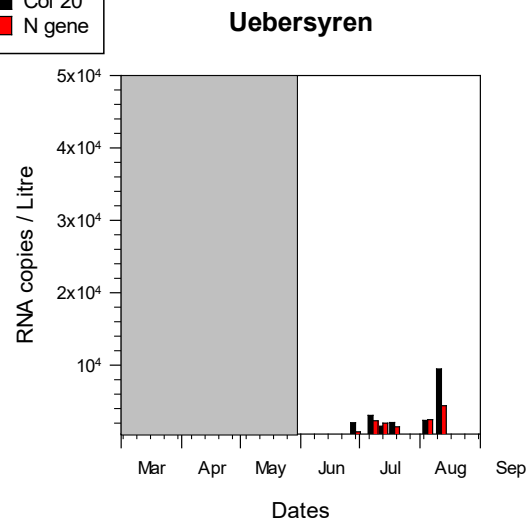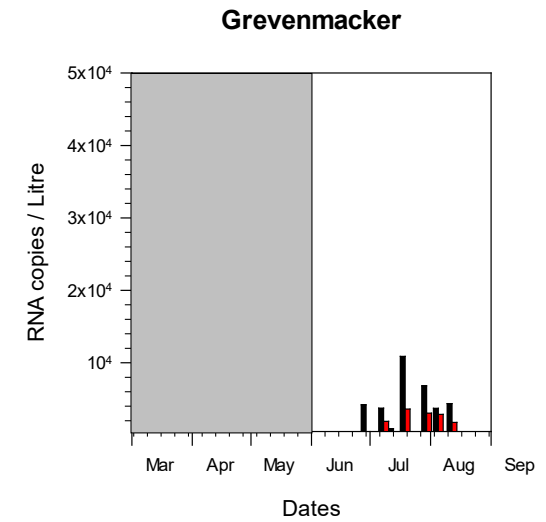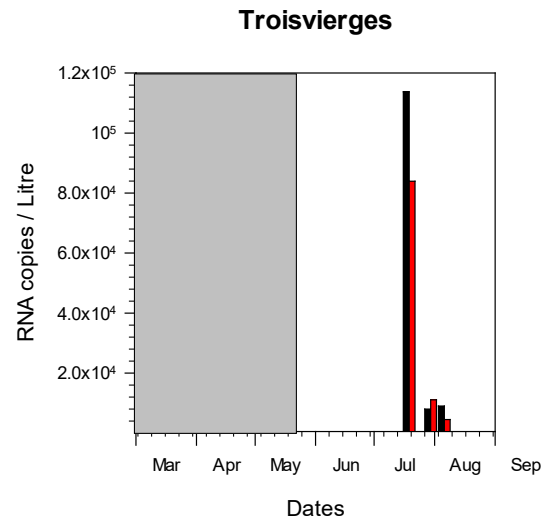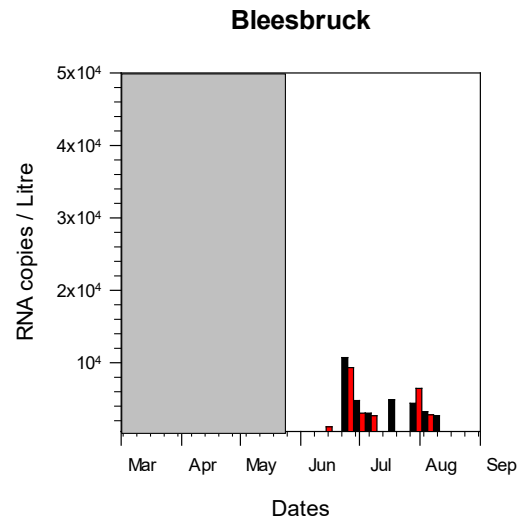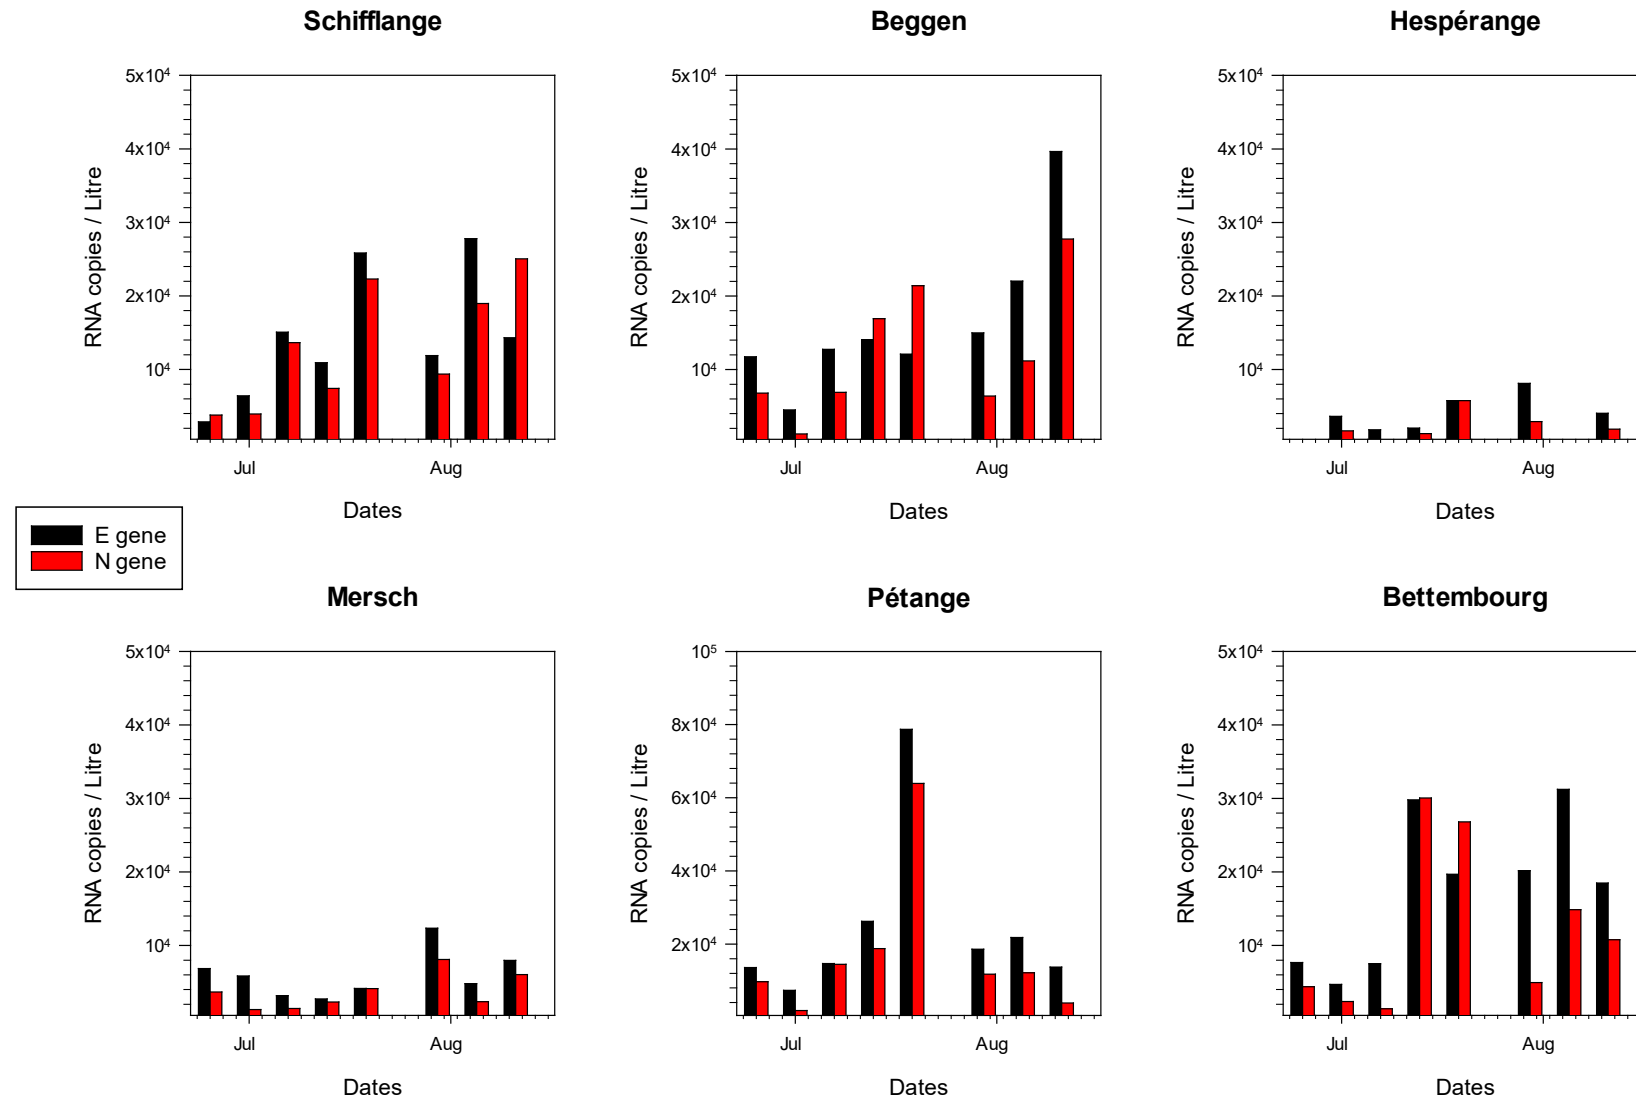


Bleesbruck

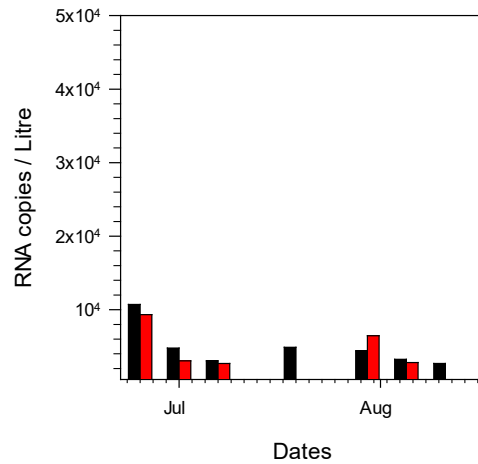


Troisvierges

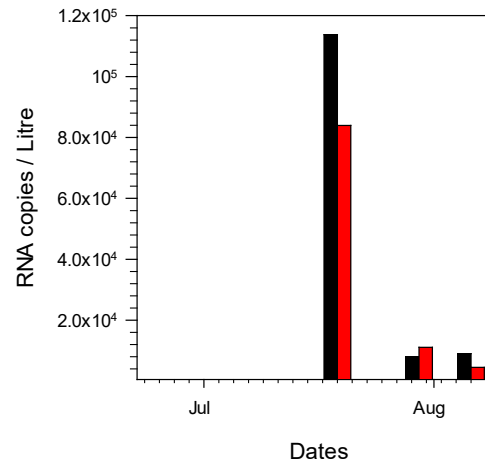


Grevenmacker

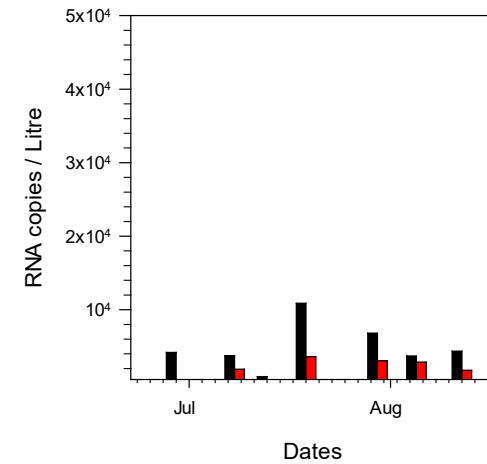

Uebersyren

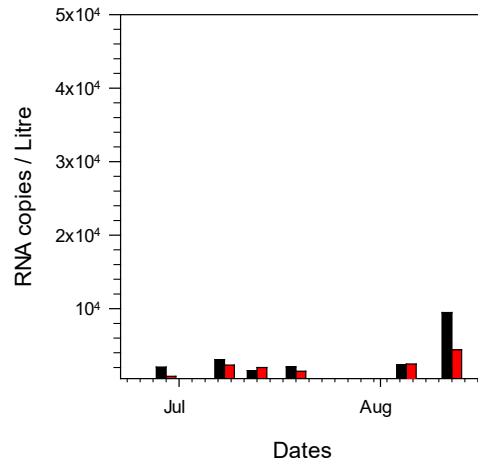

Echternach

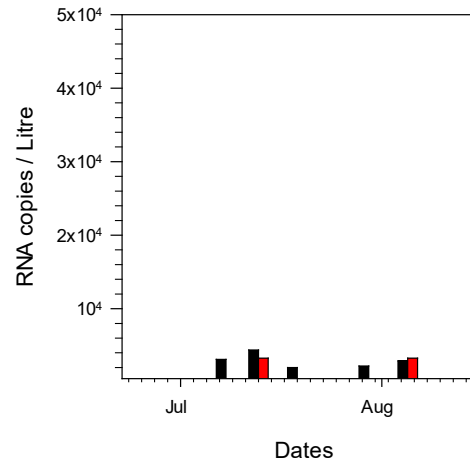

Materials and Methods

Sewage samples

From March 31st to August 13th, 2020, up to eleven WWTPs were sampled at the inlet of the plant according to the planning presented in Table 1. The operators of the WWTPs sampled a 24-h composite sample of 96 samples according to your own sampling procedure. Composite sample was stored at 4°C until sample processing.

Sample processing

The samples were transported to the laboratory at 4°C and viral RNA was isolated on the day of sampling. Larger particles (debris, bacteria) were removed from the samples by pelleting using centrifugation at 2,400 x g for 20 min at 4°C. A volume of 120 mL of supernatant was filtered through Amicon® Plus-15 centrifugal ultrafilter with a cut-off of 10 kDa (Millipore) by centrifugation at 3,220 x g for 25 min at 4°C. The resulting concentrate was collected and 140 µL of each concentrate was then processed to extract viral RNA using the QIAamp Viral RNA mini kit (Qiagen) according to the manufacturer's protocol. Elution of RNA was done in 60 µL of elution buffer.

Real-time One-Step RT-PCR

Samples are screened for the presence of *Sarbecovirus* (*Coronaviridae*, *Betacoronaviruses*) and/or SARS-CoV-2 virus RNA by two distinct real-time one-step RT-PCR, one on the E gene (Envelope small membrane protein) and the second on the N gene (nucleoprotein). The E gene real-time RT-PCR can detect *Sarbecoviruses*, i.e. SARS-CoV, SARS-CoV-2 and closely related bat viruses. In the context of the COVID19 pandemic, it can be assumed that only SARS-CoV-2 strains will be detected by this assay given that SARS-CoV virus has been eradicated and other bat viruses do not commonly circulate in the human population. The E gene assay is adapted from Corman et al. [17]. The N gene real-time RT-PCR assay (N1 assay) specifically detects SARS-CoV-2 virus. It is adapted from the CDC protocol¹. The two primers/probe sets are presented in Table 2. The RT-qPCR protocols and reagents were all provided by the LIH.

Each reaction contained 5 µL of RNA template, 5 µL of TaqPath 1-step RT-qPCR MasterMix (A15299, Life Technologies), 0.5 µL of each primer (20 µM) and probe (5 µM) and the reaction volume was adjusted to a final volume of 20 µL with molecular biology grade water. Thermal cycling reactions were carried out at 50 °C for 15 min, followed by 95 °C for 2 min and 45 cycles of 95 °C for 3 sec and 58°C (E gene) or 53°C (N gene) for 30 sec using a Viiia7 Real-Time PCR Detection System (Life Technologies). Reactions were considered positive (limit of detection – LOD) if the cycle threshold (Ct value) was below 40 cycles.

Controls

A non-target RNA fragment commercially available (VetMAX™ Xeno™ IPC and VetMAX™ Xeno™ IPC Assay, ThermoFischer Scientific) was added to the viral RNA extract from sewage concentrates as an internal positive control (IPC). This IPC-RNA is used to control the performance of the RT-qPCR (E gene) and to detect the presence of RT-qPCR inhibitors.

Viral RNA copies quantification of both targeting genes in wastewater samples was performed using RT-qPCR standard curves generated using EDX SARS-CoV-2 Standard (Biorad). This standard is manufactured with synthetic RNA transcripts containing 5 targets (E, N, S, ORF1a, and RdRP genes of SARS-CoV-2, 200,000 copies/mL each). Using such a standard, the limits of quantification (LOQ) of both RT-qPCR assays were estimated to 1 RNA copy per reaction (Figure 1).

¹ <https://www.cdc.gov/coronavirus/2019-ncov/downloads/rt-pcr-panel-primer-probes.pdf>

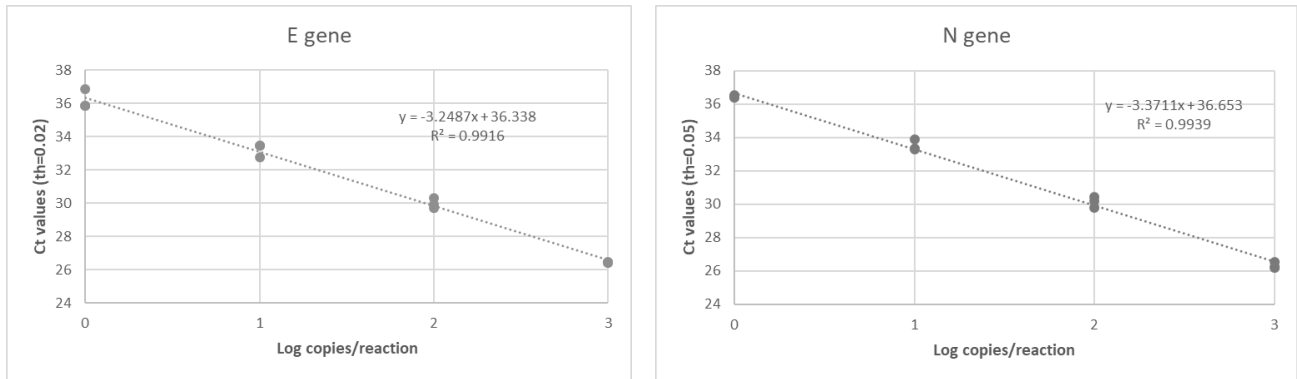


Figure 5 – RT-qPCR standard curves established for both targeting genes (E gene and N gene) of SARS-CoV-2 using a commercially available standard (Biorad).

Table 3 – RT-qPCR primer-probe sets

| Target | Primer name | Primer sequence (5' to 3') | References |
|--------|--------------------|--|---------------------|
| E gene | E_Sarbeco_F1 | 5-ACAGGTACGTTAATAGTTAATAGCGT-3 | Corman et al., 2020 |
| | E_Sarbeco_R2 | 5-ATATTGCAGCAGTACGCACACA-3 | |
| | E_Sarbeco_P1 | 5'-FAM-ACACTAGCCATCCTTACTGCGCTTCG-BHQ1 | |
| N gene | 2019-nCoV_N1_Fw | 5'-GAC CCC AAA ATC AGC GAA AT-3' | CDC |
| | 2019-nCoV_N1_Rv | 5'-TCT GGT TAC TGC CAG TTG AAT CTG-3' | |
| | 2019-nCoV_N1 Probe | 5'-FAM-ACC CCG CAT TAC GTT TGG TGG ACC-BHQ1-3' | |

Data interpretation

A sample is declared positive for the presence of SARS-CoV-2 if both targets (E and N gene) are detected with Ct values less than or equal to the LOQ. If only one target is detected or if target genes are detected with Ct values between the LOD and the LOQ, samples are reported as presumptive positive (+/-). A sample is declared negative when no target genes are detected (Ct values superior to the LOD).

In case of presumptive positive, sample is tested again using another RT-qPCR detection assay (Allplex 2019-nCoV Assay, Seegene). This commercially available detection kit is a multiplex real-time RT-PCR assay for simultaneous detection of three target genes of SARS-CoV-2 in a single tube. The assay is designed to detect RdRP and N genes specific for SARS-CoV-2, and E gene specific for all *Sarbecovirus* including SARS-CoV-2.